

EV Studio
Evergreen / Denver

771 Santa Fe Suite 200
Denver, CO 80204

303 . 670 . 7242
design@evstudio.us
www.evstudio.us


FOUNDATION NOTES

1. RE: F1.0 FOR GENERAL NOTES AND DETAILS
2. ALL FRAMING IS BY OTHER, RE: FRAMING PLANS FOR ANY DOVELS/BOLTS TO BE EMBEDDED AT TIME OF POUR
3. S.B.R. DENOTES: STEP BOTTOM OF RIB
4. INDICATES SLAB STEP
5. INDICATES SLAB SLOPE
6. INDICATES RIBS TO BE 32" DEEP. ALL OTHER RIBS TO BE 20" DEEP U.N.O. MEASUREMENTS TAKEN FROM TOP OF SLAB) MAINTAIN A MINIMUM 20" FROST DEPTH AT ALL EXTERIOR RIBS.
7. INDICATES RIBS TO BE 28" DEEP AND REINFORCED WITH (2) #5 BOTTOM BARS.
8. INDICATES SLOPED SLAB.
9. ALL RIBS TO BE 10" WIDE U.N.O.
10. ALL ELEVATIONS NOTED ON PLAN SHALL BE VERIFIED WITH PLOT PLAN PRIOR TO CONSTRUCTION.
11. ALL TENDONS SHALL BE STRESSED TO A MAXIMUM OF 33.0 Kips.
12. TENDONS LONGER THEN 75 FEET TO BE STRESSED AT EACH END, U.N.O.
13. SLAB TENDON LOCATIONS SHOWN ARE APPROXIMATE. TENDONS MAY BE MOVED UP TO 6" TO AVOID PLUMBING AND OTHER ITEMS.
14. TENDON IN LONG DIRECTION
15. TENDON IN SHORT DIRECTION

CONTRACTOR SHALL VERIFY ALL DIMENSIONS WITH ARCHITECTURAL PRIOR TO CONSTRUCTION.

PRIOR TO INSTALLING ANY ANCHORS REQUIRING DRILLING OF THE SLAB CONTRACTOR MUST VERIFY LOCATION OF TENDONS TO AVOID HITTING THEM.

BUILDING I - DESIGNED USING 'CLAY' DESIGN VALUES PER THE GEOTECHNICAL ENGINEER. REFER TO THE GENERAL NOTES ON SHEET F1.0 FOR ADDITIONAL INFORMATION.

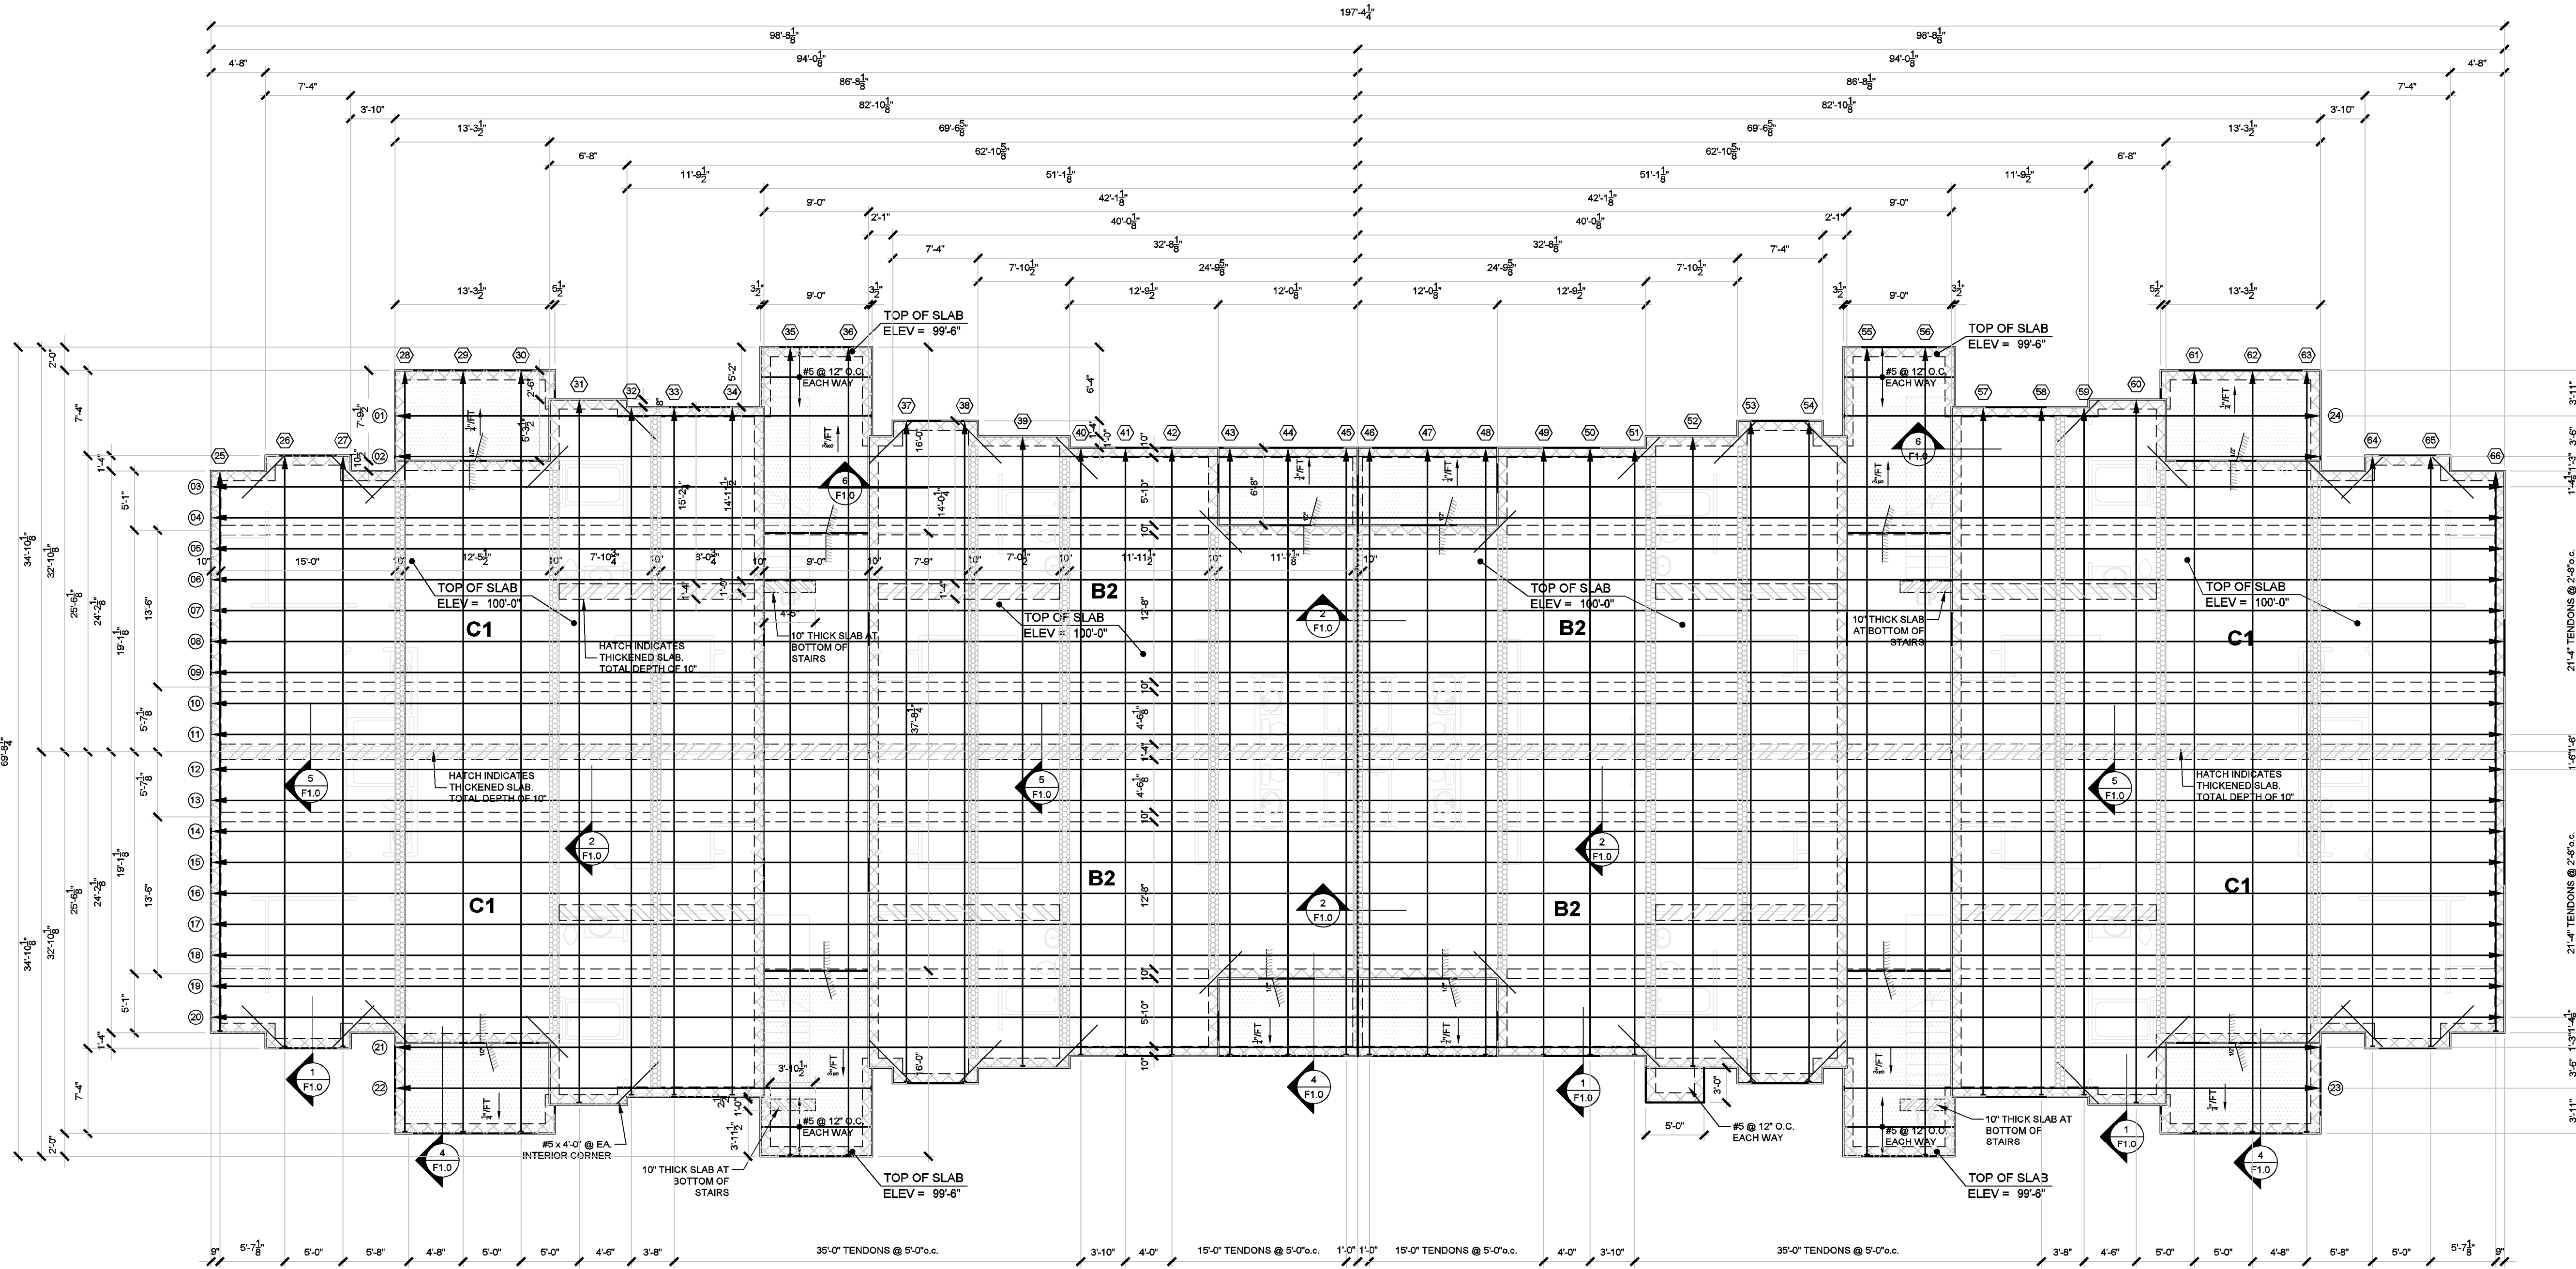

**BUILDING TYPE I
POST TENSION FOUNDATION PLAN**

1 SCALE: 1/8" = 1'-0"